

Determination of Carbon Dioxide (CO₂) Emissions from Perkins P220-3 AGO-Based Generating Plant in Variable Temperature and Relative Humidity

Sakwe Adianimovie

Department of Chemical Engineering, Federal University Otuoke, Bayelsa State, Nigeria
sakwea@fuotuokey.edu.ng

Abstract:

The main aim of this research is for the determination of Carbon-dioxide (CO₂) concentration level emitted from PERKINS P220-3 AGO-based generating plant using Series 500 Portable Air Quality Monitor with varying temperature and relative humidity. The generating plant services the facilities in the Faculty of Engineering, Federal University Otuoke (FUO), Bayelsa State. The air sampling was done for a consecutive period of twenty-one working days in the month of July, 2023. This was to ascertain the health risk that could possibly emanate from the emissions of CO₂ into the environment on the safety of personnel exposed daily to those facilities. The results were compared to “The American Society of Heating, Refrigeration and Air Conditioning Engineers (ASHRAE)” and “Occupational Safety and Health Administration (OSHA)” as <1,000 ppm limit or no severe health effect. The results showed that CO₂ have total average concentration of 898.23 ppm, total average temperature at 29.7°C and total average relative humidity at 85.81%. The overall average results showed that the CO₂ concentration emissions level were below the WHO ambient allowable limits of not more than 1000 ppm in 8 hours average.

Keywords — Environment, CO₂ concentration, Emissions Level, AGO-Based, Sampling and Monitoring, Generating Plants, Facilities, Faculty of Engineering, Temperature, Relative Humidity, Air Quality

I. INTRODUCTION

The necessity for an efficient, clean and environmentally friendly condition of an improved ambient air quality (AAQ) can never be over emphasized, owing to various methods of wasteful discharges that generate from human activities that pollute the environment, which produces particulate matter and greenhouse gases that causes global climate change (Pachauri et al., 2007, IPCC, 2013). These particulate matter and gases in excess are poisonous to human health. Some of their sources are from human nonferrous activities such as gas flaring (Etienne Romsom and Kathryn McPhail 2021), part of transportation sector (Farooq et al., (2021), wood fire (Sakwe Adianimovie and Gbeinzi Ebinimi, 2023) and others which includes electricity power

generation especially on gas turbines (Olugboji and Adepoju in 2018) as gas-base fuel, power plants (Smith et al., 2018) as well as from diesel fuel commonly called automotive gas oil (AGO). However, the effect of carbon-dioxide (CO₂) emissions is from various fuel blends of AGO-based (Hossain et al., 2020).

Gaseous pollutants thrive better with respect to humidity and temperature, as all living things survive effectively in the presence of humidity in air (Peter, 2005). Naturally, pollutant concentrations depend on the temperature and humidity of the environment, this is because relative humidity contributes to the absorption of moisture during storage of materials. Similarly, relative humidity also contributes to the regulation of the body temperature in ensuring good perspiration, it is the

B. Sampling Equipment

The main equipment used for the sampling was the Series 500 Portable Air Quality Monitor. With its special sensor head structure, the series 500 portable air quality monitor allows air quality suitable with interchangeable sensor heads that can measure up to 16 distinct pollutants appropriate for usage on a variety of applications, such as short-term fixed monitoring, personal exposure monitoring, and wide-area air quality surveys. It samples particulate matter (PM_{2.5}, PM₁₀, PM₁, TSP), and gaseous pollutants such as CO, CO₂, NO₂, VOC, O₃, SO₂, H₂S etc.

C. PERKINS P220-3 AGO-Based Generating Plant

Table 1: Major parameters of the Perkins P220-3 AGO-Based Generating Plant

S/No	Parameters	Specifications
1	Model	9011
2	Prime Power (kW)	160.0
3	Standby Power (kW)	176.0
4	Standby Power (kVA)	220
5	Noise	@ 7mt
6	Run Time	11 hours @ 75% load
7	Warranty	1 year
8	Dry Weight (KG)	1708
9	Phase	3
10	Fuel Type	Diesel

D. Automotive Gas Oil (AGO)/ Diesel

The diesel which was used for the running of the power plant throughout the sampling period was received from the direct distribution outlet of the Nigeria National Petroleum Cooperation (NNPC) Bayelsa State and must have met the standard

requirement quality assurance product specification by the NNPC/DPR (Department of Petroleum Resources) as presented in Table 2

Table 2: NNPC/DPR standard requirement quality assurance product specification

S/No	Parameters	Units
1	Density:	8.45-8.60 g/ml
2	Viscosity (at 40°C):	4.5-4.6
3	Flash Point:	74-800C
4	Octane Number:	47-52
5	Sulphur Content:	0.0516
6	Water Content:	Nil
7	Colour:	Pale Yellow
8	Appearance:	Clear and Bright

Source: (ENX Energy and Chemicals Nig. Ltd, 2023).

E. Relative Humidity and Temperature

The measurement of relative humidity and temperature was done by taking the daily average recordings directly gotten from the results of the Bayelsa State daily weather forecast (Yenagoa, Bayelsa, Nigeria Weather 2023).

F. Methods

The Series 500 Portable Air Quality Monitor was placed on the top of the PERKINS P220-3 Generating Power Plant, closed to the exhaust/waste outlet attached with the CO₂ sensor placed one meter (100 cm) away from the discharge pipe. The readings were recorded by the portable air quality monitor at 30 minutes interval for 7 hours daily for a period of 21 working days. This continues monitoring and measurement took place from 9:00 am to 4:00 pm for five days in a week (Monday to Friday) throughout the month of July, 2023. The power plant was allowed to run for a minimum of 45 minutes to enable stability at its maximum load before monitoring was done.

III. RESULTS AND DISCUSSION

The monitoring was done for 7 hours per day from 9:00 am to 4:00 pm in 30 minutes interval. Readings were taken and the average results were calculated as presented in Table 3.0 below. The computed results were compare with the ASHRAE and OSHA daily outdoor CO₂ emissions standard guidelines to ascertain the safety conditions and health risk of those daily exposed to the facilities of the Faculty of Engineering, Federal University Otuoke.

Figure 2 shows the pattern of daily carbon-dioxide release from the AGO-based power generating machine, while Figure 3 shows the daily percentage concentration of CO₂ emission respectively.

The results of the 21 days monitoring indicated that CO₂ concentration was highest on the 3rd and 16th days at 1015 ppm and 1002 ppm respectively, which occurred on the 5th and 24th of July, 2023. The temperature and relative humidity for the 3rd day were 27°C and 95.60 %, while that of the 16th day were 27°C and 94.80% respectively.

These were the only two days that the results exceeded the ASHRAE and OSHA as < 1,000 ppm limit or no severe health effect. The lowest readings of CO₂ concentration was 770 ppm and 773 ppm at temperatures of 36°C and 31°C with relative humidity of 75.90 % and 82.20 % respectively. This occurred at day 10 and day 5 been the 14th and 7th of July, 2023.

However, 19 days results showed that CO₂ concentration was below the ASHRAE and OSHA recommended limits of < 1,000 ppm limit or no severe health effect. Percentage wise, it was discovered that 90.5 % of the samples were below the recommended limits, while 9.5 % of samples were above the ASHRAE and OSHA limits.

Similarly, Figure 3 showed that 16 days out of the 21 days sampling and monitoring indicated 5 % of CO₂ emission while 5 days had 4 % equal distributions, though there were clear daily variations in figures on CO₂ concentration level as shown in Table 3 and Figure 3 respectively.

Table 3: Daily Average reading of CO₂ at Varying Temperature and Relative Humidity at Constant Time Intervals

No. of Days	Dates (July, 2023)	CO ₂ (Ppm)	Temp (°C)	Relative Humidity (%)	Time (Hrs)
1	3	950	30	85.30	7
2	4	988	29	83.60	7
3	5	1015	27	95.60	7
4	6	908	30	85.80	7
5	7	773	31	82.20	7
6	10	880	30	84.90	7
7	11	870	30	85.05	7
8	12	890	29	87.60	7
9	13	900	29	88.90	7
10	14	770	36	75.90	7
11	17	986	30	84.10	7
12	18	997	30	83.70	7
13	19	775	30	84.60	7
14	20	787	29	89.98	7
15	21	968	30	85.86	7
16	24	1002	27	94.80	7
17	25	898	30	85.00	7
18	26	907	29	85.85	7
19	27	909	29	82.90	7
20	18	800	29	85.20	7
21	21	890	30	85.08	7
Total Average		898.23	29.7	85.06	7

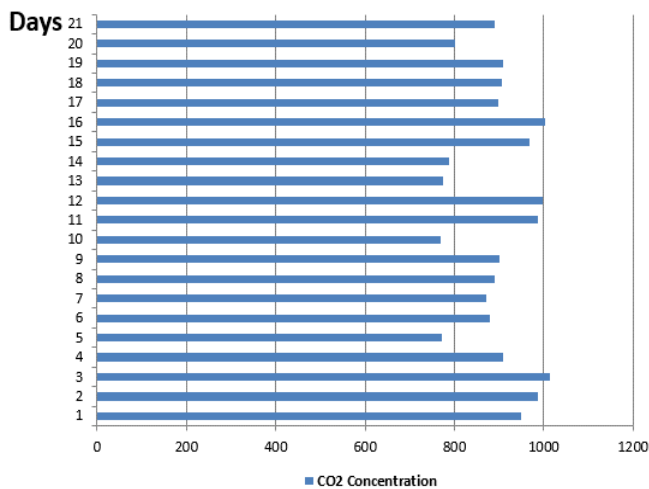


Figure 2: Daily Concentration of CO₂ Emissions

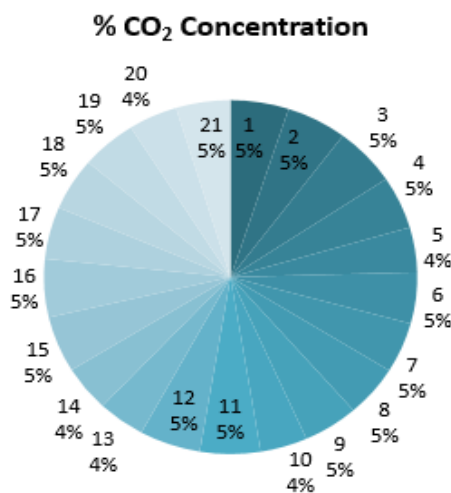


Figure 3: Daily Percentage Concentration of CO₂ Emissions

Four (4) days showed the lowest CO₂ concentration level during the sampling period which ranged between 770 ppm to 800 ppm at relatively high temperatures but low relative humidity Table 3. Furthermore, from all indications the results of the sampling showed that CO₂ concentrations vary with respect to temperature and relative humidity. That is, at higher temperature, relative humidity was low as well as CO₂

concentrations. While at lower temperature, CO₂ concentration was high as well as relative humidity (Table 3 and Figure 3).

On the overall average, CO₂ concentration level recorded was 898.23 ppm, temperature at 29.7°C and relative humidity at 85.81%. The overall average results showed that the PERKINS P220-3 AGO-based generating plant released CO₂ that was below the ASHRAE and OSHA limits of < 1,000 ppm limit or no severe health effect, indicating that personal exposure to the environment under investigation was safe and free from any health risk on the bases of CO₂ emission. However, other metrological parameters were not taken into consideration during the 21 days sampling and motoring period using the Series 500 Portable Air Quality Monitor.

IV. CONCLUSION

Efficient, liveable, sustainable, and environmentally friendly conditions of an improved ambient air quality (AAQ) is of serious concern. No doubts, humans are adversely contributing to the poor air quality in the environment and has really become an overbearing issue. These activities are from different sources such as bush burning, gas flaring, and the use of power generating plants etc. which have increased the release of greenhouse gases including Carbon dioxide (CO₂). The release of Carbon-dioxide into the atmosphere has led to several issues including climate change and global warming. In this study, CO₂ was sampled and monitored in the month of July, 2023 for 21 working days consecutively using the Series 500 Portable Air Quality Monitor in the facilities of the Faculty of Engineering, Federal University, Otuoke powered by PERKINS P220-3 AGO-based generating plant. The sampling was done with varying temperatures and relative humidity, though other metrological parameters were not under consideration. The investigation showed that personal exposure to the facilities are safe and free from Carbon-dioxide based health risks. This was because 90.5 % of CO₂ emissions were below the ASHRAE and OSHA limits of < 1,000 ppm limit or no severe health effect,

as compared to the 9.5% that was above the standards.

While the results in this study indicated low release of Carbon-dioxide into the atmosphere, other air pollutants like PM_{2.5}, PM₁₀, PM₁, TSP, and gaseous pollutants such as CO, NO₂, VOC, O₃, SO₂, H₂S etc which are also constituents of AGO-based fuel, were not analyzed. Therefore, to be certain of the overall safety of those who access the facility, it is recommended that further studies should be carried out to expand the scope on the power plant.

ACKNOWLEDGMENT

The author does acknowledge Otong Daniel in the Department of Chemical Engineering, Faculty of Engineering, Federal University Otuoke (FUO), Bayelsa State on his project work.

REFERENCES

- Bilici, M. (2018). Environmental impacts of electricity production from fossil fuels. *Renewable and Sustainable Energy Reviews*, 81(1), 2148-2157. doi: 10.1016/j.rser.2017.06.031
- Ede, P.N. and Edokpa, D.O. (2015) Regional Air Quality of the Nigeria's Niger Delta. *OpenJournal of Air Pollution*, 4, 7-15. <https://doi.org/10.4236/ojap.2015.41002>.
- ENX Energy and Chemicals Nigeria Limited. Published February 16, 2023
- Etienne Romsom and Kathryn McPhail 2021. Capturing economic and social value from hydrocarbon gas flaring and venting: solutions and actions.
- Farooq, M. A., Ali, M., & Ahmad, S. (2021). Simulation-based estimation of CO₂ emissions from automobile gas oil (AGO) based power plants in Pakistan. *Environmental Science and Pollution Research*, 28(14), 17613-17622.
- Hossain, M. A., Islam, M. A., & Al-Mamun, M. R. (2020). CO₂ emissions from automobile gas oil-based power plants in Bangladesh: Impact of fuel blends. *Journal of Cleaner Production*, 246, 119019.
- Intergovernmental Panel on Climate Change. (2006). IPCC Guidelines for National Greenhouse Gas Inventories (Vol. 5). <https://www.ipcc-nggip.iges.or.jp/public/2006gl/vol5.html>
- International Energy Agency 2016a Energy and Air Pollution. World Energy Outlook Special Report (Paris, France)
- International Energy Agency 2016b World Energy Outlook 2016 (Paris, France)
- Nizamuddin, M., Soroush, A., Levrèse, G., & El-Zein, A. (2020). Performance analysis and environmental impact of a diesel power plant in developing countries: Case study of Lebanon. *Environmental Science and Pollution Research*, 27(10), 10021-10030.
- OGUNLOWO, OO and SAKWE, A. Evaluation of Lead and Iron Content in Different Stages of Water Treatment Facilities within Otuoke and Yenagoa Metropolis, Bayelsa State, Nigeria. *J. Appl. Sci. Environ. Manage.* Vol. 27 (11) 2415-2420 November 2023
- Olugboji, O. A., & Adepoju, A. A. (2018). Economic and environmental evaluation of gas turbine power plant: The case of Nigeria. *Energy Reports*, 4, 690-696.
- Pachauri, R K., and Babu Jallow. "Climate Change 2007: The Physical Science Basis." Graphics, Presentations, and Speeches. 2007.
- Peter Apert 2005. Integrative and Comparative Biology, Volume 45, Issue 5, November 2005, Pages 683-684, <https://doi.org/10.1093/icb/45.5.683>.
- Sakwe Adianimovie and Gbeinzi Ebinimi. Investigation of Particulate Matter (PM₁₀ & PM_{2.5}) and Gaseous Pollutants (CO₂ & CO) in Houses Using Kerosene Cooking Stoves & Wood Fire in Attisa 3, Bayelsa State, Nigeria
- Smith, A., Johnson, B., & Thompson, C. (2018). Assessing CO₂ emissions from AGO-based generating plants: An analysis of plant efficiency, fuel composition, and operational practices. *Environmental Studies*, 45(3), 123-145.
- Smith, A., Johnson, B., & Thompson, C. (2018). Assessing CO₂ emissions from AGO-based generating plants: An analysis of plant efficiency, fuel composition, and operational practices. *Environmental Studies*, 45(3), 123-145.

Smith, J. (2021). The environmental impact of various businesses. *Journal of Environmental Studies*, 45(3), 56-78.

<https://doi.org/10.1080/123456789.2021.1234567>

www.co2Meter.com/blogs/news/8487325.Measuring-Carbon-dioxide-in-outdoor-air. October 5, 2022.. Access: 2nd December, 2023.

www.osha.gov/dts/chemicalsampling/data/CH_225400.html
Access: 2nd December, 2023

www.who.int/news-room/feature-stories/detail/what-are-the-who-air-quality-guideline-2021. Access: 2nd December, 2023

Yenagoa, Bayelsa, Nigeria Monthly Weather | AccuWeather. 2023 -
<https://www.accuweather.com/en/ng/yenagoa/252198/july-weather/252198>. Access: 5th December, 2023

Zhang, W., Li, C., Liu, X., & Wang, J. (2019). Data-driven estimation of CO₂ emissions from automobile diesel oil (ADO) and automobile gas oil (AGO) based power plants in China. *Journal of Cleaner Production*, 229, 561-571.